177230 Seismic Transmitter

Datasheet

Cordant™

177232 Rev. U



Description

The 177230 Seismic Transmitter is a simple, loop-powered device that can be quickly and easily installed. It can be integrated into your programmable logic controller (PLC) or controls system linked to a plant asset condition monitoring solution. Its simple design reduces training, maintenance, and service costs. The transducer helps you better manage downtime, optimize maintenance planning, and avoid unforeseen catastrophic failures of machinery assets.

The 177230 Seismic Transmitter incorporates robust CM design for reliability and implements an industry-standard 4 to 20 mA loop-powered transmitter.

Easily Installed and Integrated

- Interfaces with PLCs and control systems (including DCS and SCADA).
- Requires only a short learning curve for operations and maintenance, through a familiar interface similar to that for connecting other PLC or control system inputs.
- Requires no field configuration or adjustments.
- Needs few additional parts for a complete system.
- Includes technical support for customers on how to monitor their equipment.
- Includes self-test.
- Incorporates protected interface.
- Supports a variety of interface cables.

Data Quality

- Provides accurate and repeatable data.
- Uses simple data format.
- Provides raw vibration signal for verification and analysis.

Baker Hughes

EHS Compliant

- Implements safe and ergonomic design.
- Supports access to hazardous areas.

Specifications

Electrical

Excitation Voltage	12 to 30 Vdc (Current limited to 40 mA)

This product is for use with PLCs, DCS, and SCADA systems that have internal power supplies which are typically current limited in the range of 30 mA to 35 mA.

Settling Time	Less than 15 seconds within 2% of final value
Mounted Resonant Frequency	Greater than 12 kHz
Transverse Sensitivity	Less than 5% of sensitivity
Sensing Element Type	Ceramic / Shear
Connector Wiring Convention	
Pin A	4-20 mA Positive Loop (Positive with reference to Pin B)
Pin B	4-20 mA Loop Return (Negative Loop Return for Pin A and common for Dynamic Signal)
Pin C	Dynamic Acceleration Signal (Unbuffered, referenced to Pin B)

The Dynamic Signal Negative (Pin B) requires isolation from any grounding. If this terminal is grounded, the 4-20 mA loop will short, resulting in no output.

Velocity Output	
Output Signal	4 to 20 mA Current Loop from Pin A to Pin B
Full Scale Range (-AA)	**00** - 12.7 mm/s (0.5 in/s) ± 10% **01** - 25.4 mm/s (1.0 in/s) ± 10% **02** - 50.8 mm/s (2.0 in/s) ± 10% Full Scale, broadband RMS (Root Mean Square)
Sensitivity – Main Loop	4 ± 0.3 mA equals 0.0 mm/s 20 ± 2 mA equals Full Scale Range
Frequency Response (-BB)	**01** - 10 Hz to 1 kHz ± 10% (600 cpm to 60 kcpm ± 10%) Output signal is proportional to the RMS vibration levels. **02** - 3 Hz to 1 kHz ± 10% (180 cpm to 60 kcpm ± 10%) Output signal is proportional to the peak vibration levels.
Acceleration Output	
Output Signal	Unbuffered Voltage from Pin C to Pin B (Reference)
Sensitivity	10.2 mV/m/s^2 (100 mV/g) ± 20%
Full Scale Range	147 m/s^2 (15 g) peak
Frequency Response	2.5 Hz to 10 kHz ± 10% (150 cpm to 600 kcpm ± 10%)
Linearity	± 1% of Full Scale
Output Bias	2.5 V ± 0.1 V (Referenced to Pin B)

Environmental Limits

Operating Temperature	-40°C to +85°C (-40°F to +185°F)
Electrical Isolation	Greater than 10^8 ohms
Isolation Breakdown Voltage	600 V_{rms} with less than 1 mA leakage current
Shock Survivability	9.810 m/s^2 (1.000 g peak), maximum drop test

This part typically mounts directly to the machine via a stud. Customers can use this device with a magnetic base, but must take care not to “snap” the unit onto the machine. This snapping action can create a very large spike signal that can damage the electronics. Rolling the magnetic-base onto the machine greatly reduces the spike signal so that the unit should not have any issues.

Sensor Seal	Hermetically sealed
Relative Humidity of Transmitter	To 100% non-submerged
Magnetic Field Sensitivity	Less than 20 µm/s/gauss (790 µin/s/gauss) peak Less than 14.7 mm/s^2/gauss (150 µg/gauss) peak [based on 50 gauss, 50 - 60 Hz]

Physical

Weight	131 g (4.62 oz), typical
Diameter	25.4 mm (1.00 in)
Height	66.0 mm (2.60 in)
Case Material	316L stainless steel
Connector	3-pin MIL-C-5015, 316L stainless steel
Mounting Hole	¼-28 UNF
Mounting Threads	M6 X 1 SI M8 x 1.25 SI ¼-28 UNF

These stud adapters are provided with each device. For additional adapters, see Ordering Information on page 7. Or contact Benty Nevada Tech Support.

Mounting Torque	4 to 7 N-m (35.4 to 62.0 in-lbf)

Compliance and Certifications

FCC

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:

- This device may not cause harmful interference.
- This device must accept any interference received, including interference that may cause undesired operation.

EMC

EMC Directive 2014/30/EU

RoHS

RoHS Directive 2011/65/EU

China RoHS

Cables associated with the product(s) mentioned in this datasheet have an EFUP designation of 15 years, in accordance with SJ/T 11364-2024.



Maritime

ABS Marine Vessels

Offshore Units and Structures

Mobile Offshore Units

ATEX

60079-01

60079-07

60079-11

60079-15

ATEX Directive 2014/34/EU

Hazardous Area Approvals

For the detailed listing of country and product-specific approvals, refer to the *Approvals Quick Reference Guide (108M1756)*.

For additional technical documentation, please log in to bntechsupport.com and access the Bently Nevada Media Library.

cNRTLus

Ex nL IIC T4:
AEx nA IIC T4:
Class I, Div 2, Groups A, B, C, D.

Ex ia IIC T4:
AEx ia IIC T4:
Class I, Div 1, Groups A, B, C, D;
Class II, Div 1, Groups E, F, G;
Class III, Div 1

Install per drawing 177234

T4 @ Ta ≤ 80°C

ATEX/IECEx

177230	II 1 G Ex ia IIC T4 Ga II 3 G Ex na IIC T4 Gc T4@ Ta = -40°C to 80°C
Entity Parameters	**Zone 0/1**: Ui= 28 V; Ii= 120 mA; Pi= 1 W; Ci=0; Li=121.06 µh **Zone 2**: Ui= 28 V; Ii= 120 mA; Pi= 1 W

Hazardous Area Conditions of Safe Use

ATEX/IECEx

Zone 0/1:

Equipment must be connected to equipment, which meets the above listed entity parameters.

The cables type A or B (in compliance with EN 60079-25) must respect the cable parameters listed with the entity parameters.

Zone 2:

The supply electrical parameters shall not exceed the values mentioned in the tables above.

Ordering Information

For the detailed listing of country and product-specific approvals, refer to the *Approvals Quick Reference Guide (108M1756)*.

For additional technical documentation, please log in to bntechsupport.com and access the Bently Nevada Media Library.

Seismic Transmitter

177230-AA-BB-CC

A: Measurement Range	
00	0 - 12.7 mm/s (0 - 0.5 in/s)
01	0 - 25.4 mm/s (0 - 1.0 in/s)
02	0 - 50.8 mm/s (0 - 2.0 in/s)
B: Frequency	
01	10 Hz to 1 kHz (600 to 60 kcps) RMS (Root Mean Square)
02	3 Hz to 1 kHz (180 to 60 kcps) peak
C: Approvals	
05	Multiple Approvals (CSA/NRTL/C, ATEX/IECEx)

Only standard or common AA-BB-CC configurations are available.

Interconnect Cable without Armor

16925-AA

A: Length in feet
Order in increments of 1 foot (0.3 m)
Minimum length: 3 feet (0.91 m) Maximum length: 99 feet (30.2 m) Example: **25** = 25 feet

These standard lengths are available. You can order custom lengths at additional cost.

Feet	Meters (approx.)
10	3.1
12	3.6
15	4.5
17	5.0
20	6.0
25	7.6
30	9.0
99	30.0

Interconnect Cable with Armor

16710-AA

A: Length in feet
Order in increments of 1 foot (0.3 m)
Minimum length: 3 feet (0.91 m) Maximum length: 99 feet (30. 2m) Example: **25** = 25 feet

These standard lengths are available. You can order custom lengths at additional cost.

Feet	Meters (approx.)
08	2.4
10	3.1
12	3.6
15	4.5
17	5.0
20	6.0
30	9.0
99	30.0

Ordering Accessories

You can order these accessories from the vendors named. Contact the vendor with the part number and ask for their part that fits your application.

3-Pin Connector (MIL-C-5015)

Base	Cannon (ITT industries) ittcannon.com P/N: CA3106R-10SL-3S F97 or P/N: MS3106R-10SL-3S
Shell	Sunbank Co. sunbankcorp.com
	Glenair, Inc. glenair.com
Wire (3-wire with shield)	Three-conductor 18 to 22 AWG cables with a 0.01” minimum outer jacket and inner wire insulation, and 80% minimum coverage shield. Insulation rating should be 600 V minimum.
Mil-W-16878/4 (Type E)	Sonic/Thermax thermaxcdt.com 18 AWG - P/N: 18-TE-1930 (3) SXE 22 AWG - P/N: 22-TE-1934 (3) SXE
	Standard Wire and Cable Co. std-wire.com 18 AWG - P/N: 1100-88T 22 AWG - P/N: 1100-66T
	Belden belden.com 18 AWG - P/N: 83336 22 AWG -P/N: 83334

Studs and Adapters

Part No.	Description
89139-01	M-M ¼-28 UNF to ⅜-24 UNF standard stud
128038-01	M-M ¼-28 UNF to ⅜-24 hex plate stud (1-⅜” X 0.25”)
146396-01	F-M ¼-18 NPT to ¼-28 adapter
146394-01	F-M ¼-28 UNF to ¼-18 NPT adapter
37439-01	F-M ¼-28 UNF to ¼-28 UNF mounting base
164373	M-M ¼-28 UNF to ¼-28 UNF standard stud with brass tip
135826-01	M-M ¼-28 UNF to M10 X 1.0 standard stud

Graphs and Figures

Dimensions shown in mm (inches) except as noted.

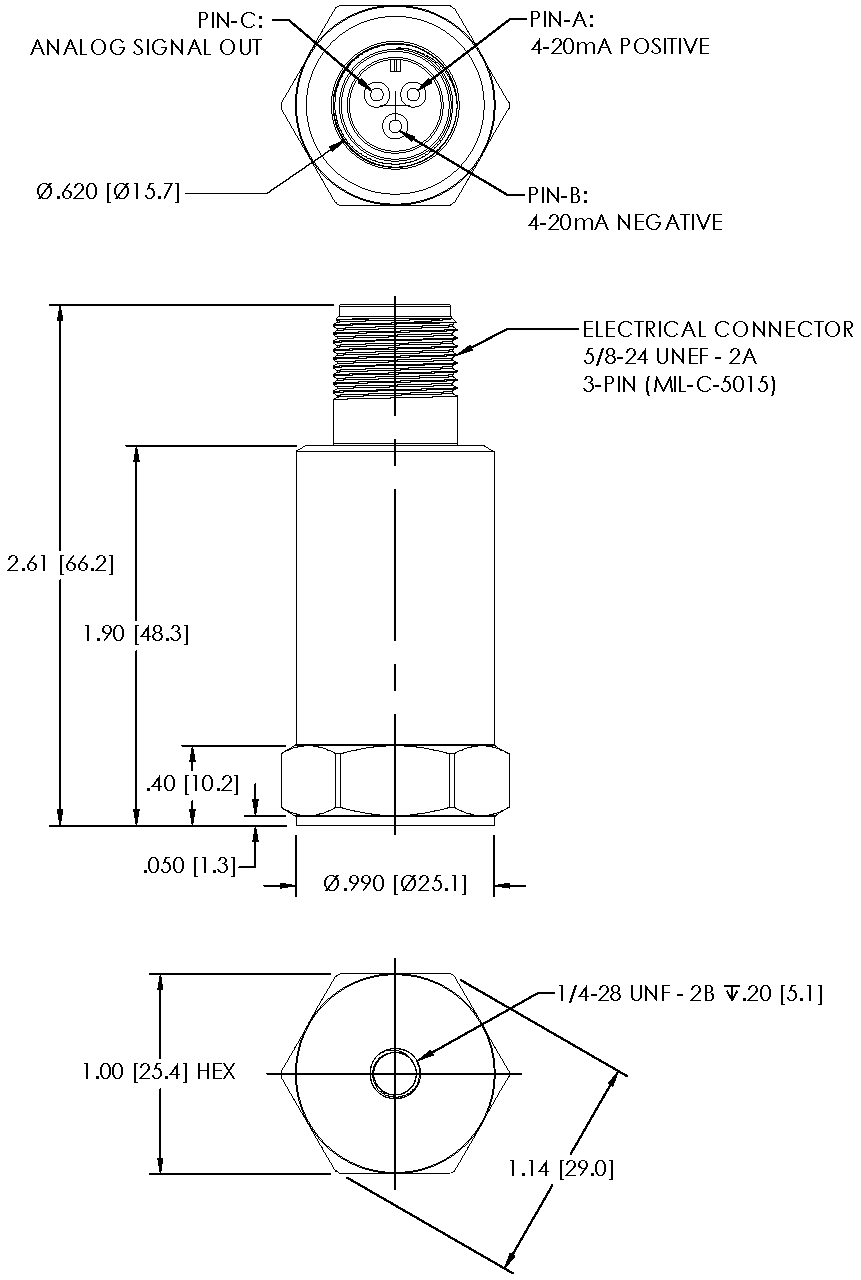


Figure 1: Transducer Mechanical Outline and Dimensions

Approvals Quick Reference Guide

Country Specific Ordering Options

Cordant™



108M1756 Rev. AV

Document Summary

This reference guide represents an overview of all country-specific approvals available for customer order listed by product.

1. Approval Options in Use
   An overview of each country code option, with appropriate markings and requirements.
   - -00 approval option (No Approvals) on page 3.
   - -01 approval option ('NORTH AMERICA' or 'C/US' or 'cNRTLus' Approvals) on page 4.
   - -02, -05 approval option (Multi-Approvals) on page 5.
   - Country Specific Approvals on page 6.
2. Quick Reference by Product
   A quick reference table by product type and part number to identify which country-specific approvals are available to order.
   - Monitors
   - Portables
   - Radio Devices
   - Distributive
   - Transducers
   - Orbit60

Baker Hughes

Region/Country	Area of Use	-Option	Country Specific Sample Marking	Description
China	**Safe Area**	**-CN0**	 or	Choose this approval option for safe area use when available. Covers the general requirements such as CN RoHS, EMC, LVD and Radio Type Approval as applicable. When not available/not applicable: - Choose -00 for safe area use Note: For Velomitors and Accelerometers where no "-CN0" option is available, choose "-CN" approval option as it provides necessary markings.
	Hazardous Area	**-CN**	 or	Choose this approval option for hazardous area use, covers the NEPSI/CCC requirements as applicable. Covers Radio Type Approval for wireless devices. Includes ATEX/IECEx hazardous area markings and rating on the product as applicable. Note: Choose this for any new 3500 product orders to China due to issues with the -00 label at customs clearance. This is valid until the product line goes to P3. Spares are not affected.
Guyana	**Safe or Hazardous Area**	**–GY**		Choose this approval option for safe area/hazardous area use when available. Covers Guyana Radio Type Approval and the general/hazardous area requirements as applicable. When not available/not applicable: - Choose -00 for safe area use - Choose -02 or -05 for hazardous area use
Indonesia	**Safe or Hazardous Area**	**–ID**	QR code and certificate information required	Choose this approval option for safe area/hazardous area use when available. Covers Indonesia Radio Type Approval and the general/hazardous area requirements as applicable. When not available/not applicable: - Choose -00 for safe area use - Choose -02 or -05 for hazardous area use

Transmitters																				
P/N	00	01	05	AE	AE0	AU	BR	CN	CN0	IN	K0	KR	KZ	MA	MA0	NZ	R0	RU	TW	U0	ZA
177230	×	×	✓	✓	✓	✓	✓	✓	✓	✓	×	✓	✓	×	×	✓	✓	✓	✓	✓	✓
990	✓	✓	✓	✓	✓	×	✓	✓	×	✓	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓
991	✓	✓	✓	✓	✓	×	✓	✓	×	✓	✓	✓	✓	×	×	×	✓	✓	✓	✓	✓

Sensor Accessories																															
P/N	00	01	02	04	05	AE	AE0	AU	AZ	AZ0	BR	BY	BY0	CN	IN	JP	K0	KR	KZ	MA	MA0	NZ	R0	RU	TW	U0	UA	UK	UZ	UZ0	ZA
102044	✓	×	×	×	✓	×	×	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	×	×	✓	✓	✓	✓
102045	✓	×	×	×	✓	×	×	×	✓	✓	✓	✓	✓	✓	✓	×	✓	✓	✓	×	×	×	✓	✓	✓	×	×	×	✓	✓	✓
128164	✓	×	×	×	✓	✓	✓	×	×	×	×	×	×	✓	×	×	✓	×	✓	×	×	×	✓	✓	×	✓	✓	✓	×	×	×
129715	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	✓	✓	✓	✓	✓	✓	✓	×	×	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
129716	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
129957	✓	×	×	×	✓	×	×	×	✓	✓	✓	×	×	✓	✓	✓	✓	✓	✓	×	×	×	✓	✓	✓	×	×	×	×	×	✓
130938	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	×	×	✓	✓	✓	✓
131908	✓	✓	×	×	✓	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×
132306	×	✓	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×
134340	✓	×	×	×	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
137383	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	×	✓	✓	✓	×	✓	✓	✓	×	×	×	✓	✓	×	✓	✓	✓	×	✓
142238	✓	×	×	×	✓	×	×	×	✓	✓	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓
142810	✓	✓	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×
143493	✓	×	×	×	✓	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	✓	✓	×	×	×	✓	×	×	×
144181	✓	×	×	×	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	×	×	✓	✓	✓	✓
162380	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
162381	✓	×	×	×	✓	✓	×	×	×	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
168209	✓	×	×	×	✓	✓	✓	×	×	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	×	✓	✓	✓	✓	✓	✓	✓	✓	✓
170133	✓	×	×	×	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×
170172	✓	×	×	×	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×
175636	✓	×	×	×	✓	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×

Baker Hughes

APTERPLC TECHNICAL INQUIRY

Bently Nevada 177230 Seismic Transmitter

177230-01-01-CN

Send these details with your RFQ

01 Complete readable product nameplate, including every revision letter or suffix

02 Required quantity, destination and requested delivery date

03 Connected probe, cable, sensor, I/O or power-module part numbers

04 Mounting and cabinet photos that show connectors, clearances and wiring

05 Operating voltage, measurement range, approvals and site conditions

06 Description of the fault, alarm, startup issue or replacement objective

JimPei **+8618020776782** **sales1@apterpower.com**

ApterPLC inquiry checklist - not a Baker Hughes manufacturer page.